



FIRE ACTIVITY REPORT

City of Malibu | February 2026

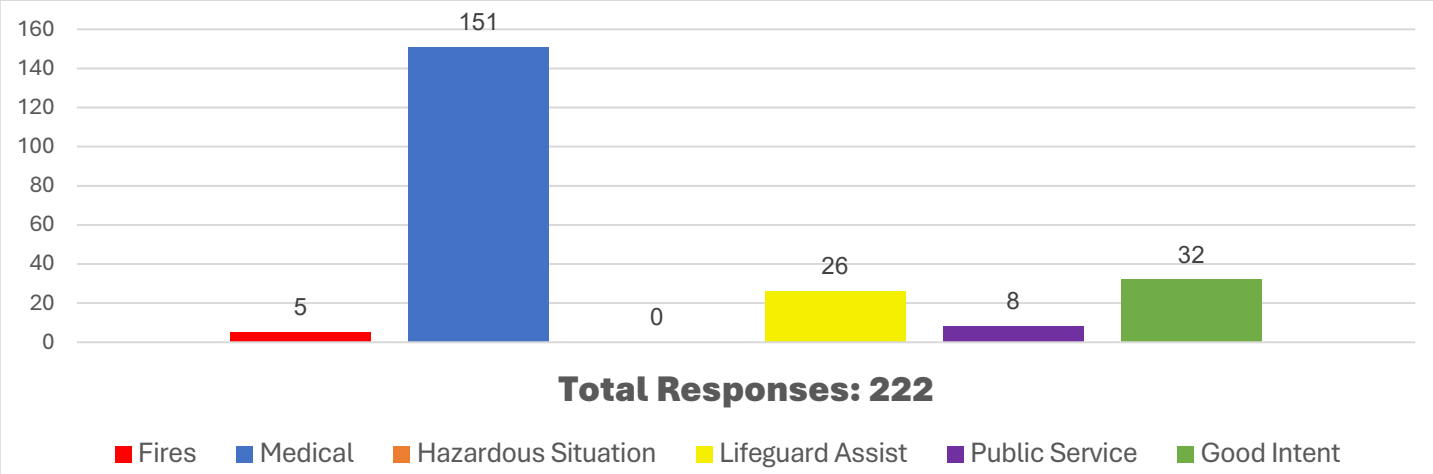

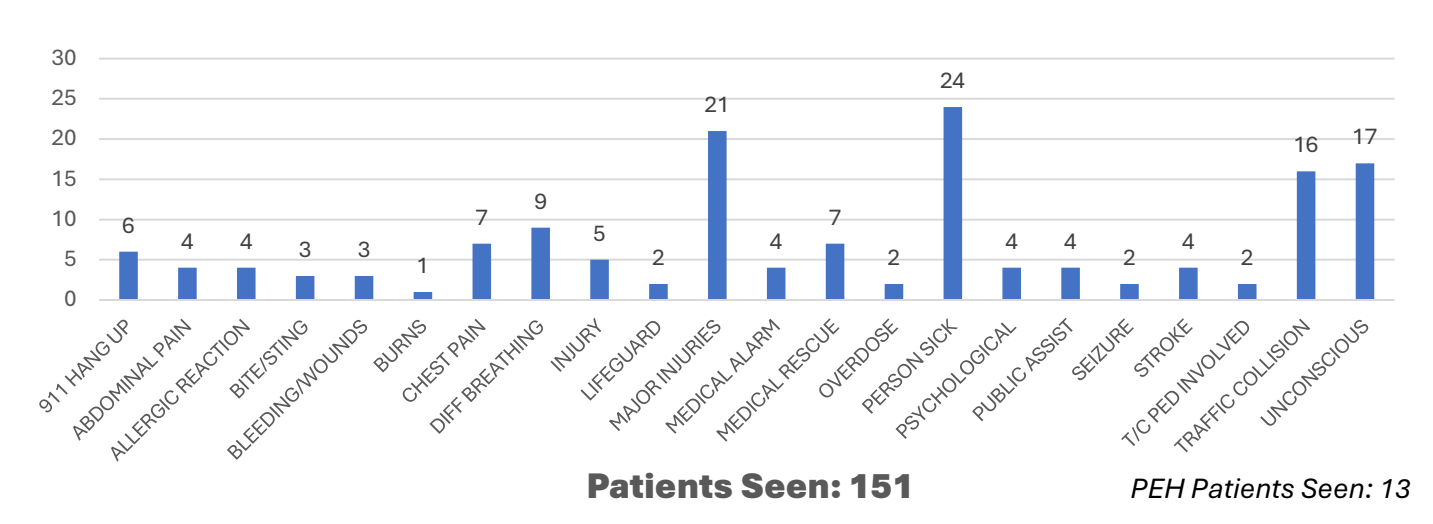

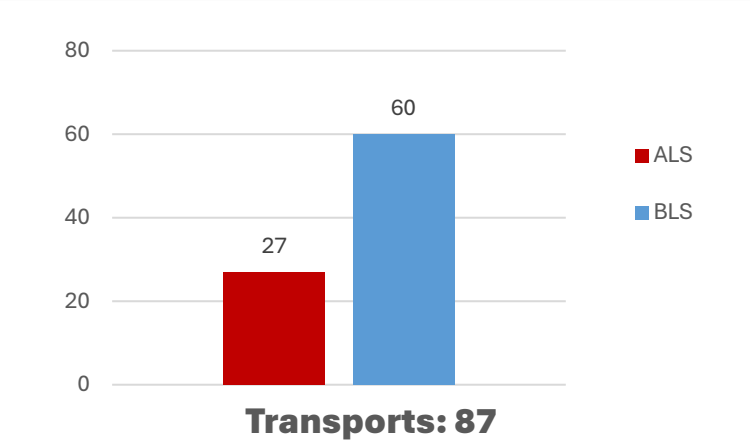

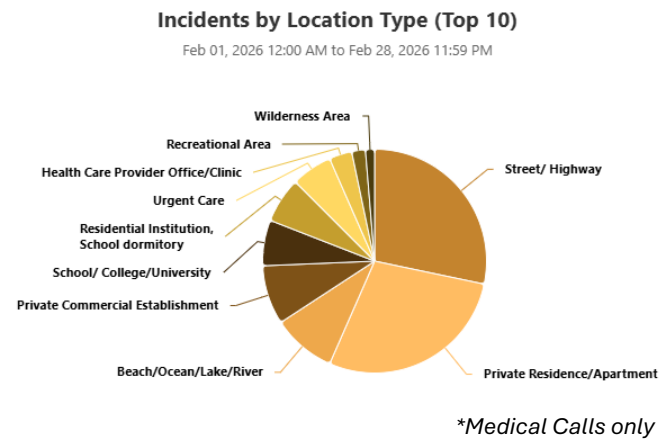

Advanced Life Support (ALS) Transports: patient transported to hospital in ambulance with paramedic on board;
Basic Life Support (BLS) Transports: patient transported to hospital without paramedic on board

FIRE ACTIVITY REPORT

City of Malibu | February 2026

Fire Incidents:

Date	Type	Address	Narrative
02/01/26	**Outside Fire**	BAYSHORE Dr	Bonfire on the beach x 2, extinguished with sand and public educated about illegal burns on beach.
02/06/26	**Outside Fire**	22664 PCH	PEH warming fire. Put out by PEH upon FD arrival
02/07/26	**Outside Fire**	25653 PCH	Outdoor campfire
02/07/26	**Structure Fire**	7061 BIRDVIEW	E71 arrived to find residents outside of the reported address with nothing showing. Upon investigation it was determined that there was a very small fire contained to the upstairs fireplace in the hearth area involving electrical equipment within the fireplace. E71 extinguished the fire using the dry chemical extinguishers while minimizing the impact from the extinguisher to the room. E71 personnel then isolated the power to the fireplace at the electrical panel, isolated the gas from the fireplace, and removed the damaged fire place equipment to the exterior of the home. No signs of extension from the inside of the heat shielded area of the fireplace were found. Prior to departing the scene E71 conducted sensit gas monitoring in the room to check for the presence of gas finding none and instructed resident to recontact 911 if anything additionally concerning is observed.
02/23/26	**Outside Fire**	PCH	E71 On scene to find a dumpster located outside the Malibu Hotel on fire. The fire was extinguished successfully with Reel Line and Foam, no injuries to Firefighter's nor Civilians. Spoke with witnesses on scene and passerby's, cause remains under investigation by LASD resources.

Other Incidents:

Date	Type	Address	Narrative