

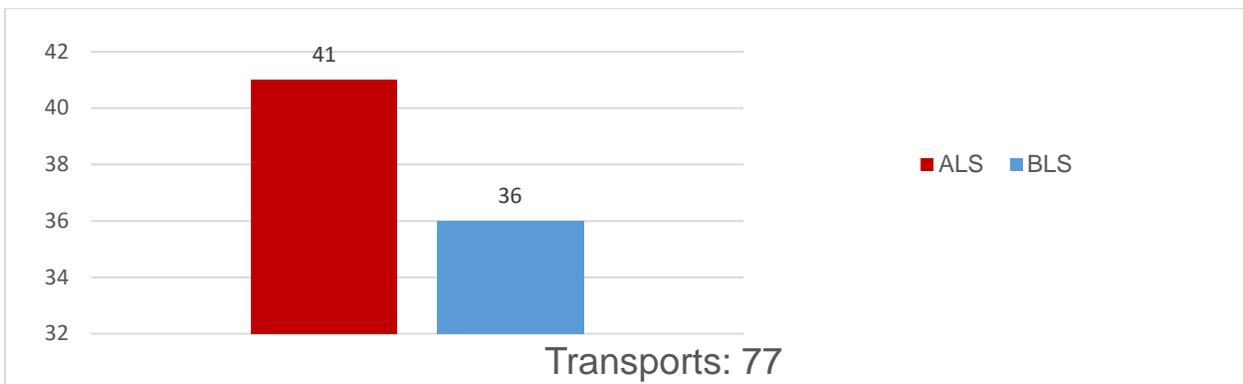


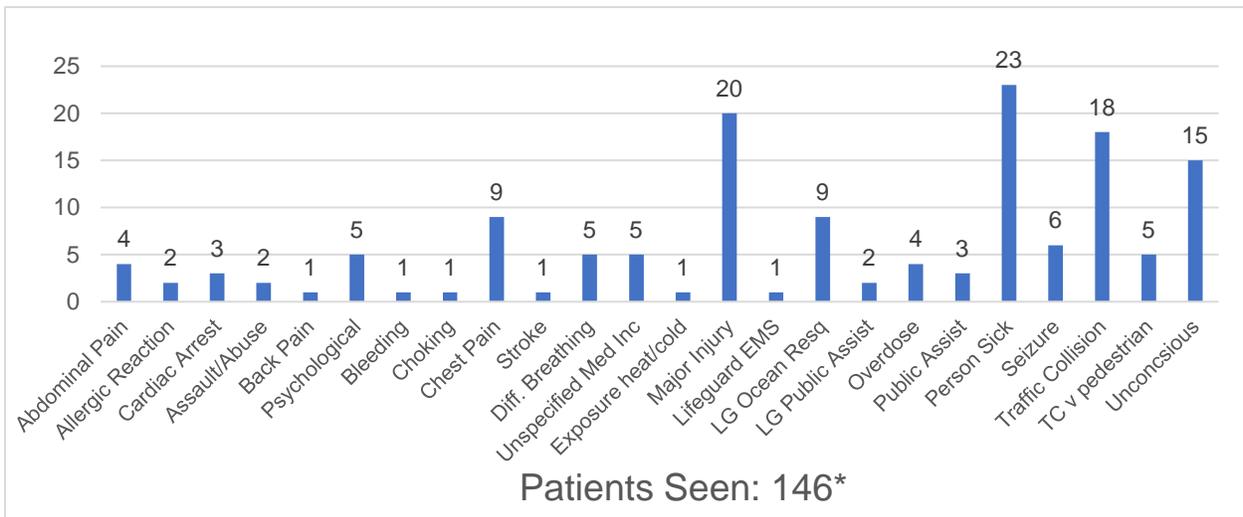

FIRE ACTIVITY REPORT

City of Malibu | February 2022

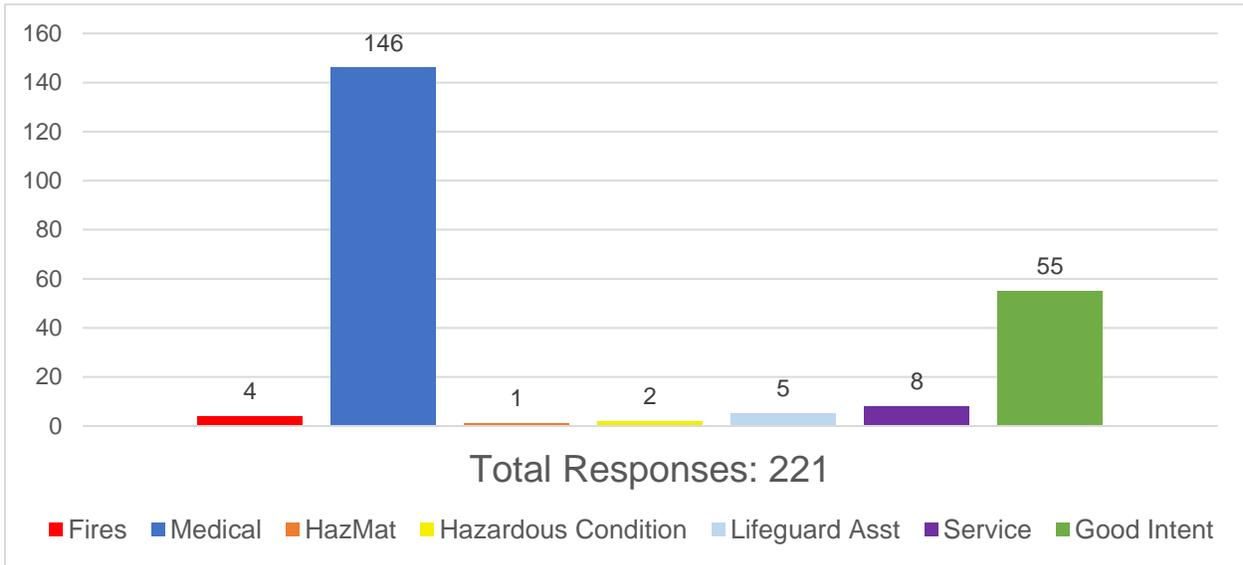

ALS Transports: accompanied by paramedic; **BLS Transports:** no paramedic on board

*Patients Seen total will be higher than Medical Calls total in first graph if there were multiple patients at one incident.



FIRE ACTIVITY REPORT

City of Malibu | February 2022

FIRE INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
02/11/22	Structure Fire	22716 PACIFIC COAST Hwy	Fire was determined to have started in kitchen hood system during normal business operating hours. Grease collected inside hood system ignited and heated ducting to the roof. Extensive overhaul operations on the roof and second floor walls were required to ensure full fire extinguishment. Two minor firefighter injuries occurred and were treated on scene. Approx. 50 occupants were evacuated from the premises with no civilian injuries.	Property: \$200,000.00 Contents: \$50,000.00
02/14/22	Cooking Fire	22812 PACIFIC COAST Hwy	No fire, stove burner was smoking.	Property: \$0.00 Contents: \$100.00
02/15/22	Fire, other	23038 PACIFIC COAST Hwy	Beach campfire, extinguished after arrival.	Property: \$500.00 Contents: \$0.00
02/20/22	Structure Fire	6162 LA GLORIA Dr	Fire in sauna, caused by faulty electrical wiring.	Property: \$200,000.00 Contents: \$25,000.00
			TOTAL:	Property: \$400,500.00 Contents: \$75,100.00

OTHER INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
02/12/22	Haz Cond	23000 PACIFIC COAST Hwy	6ft x 12ft wood beam broke loose from Malibu Pier and washed up on beach. Beam towed off beach and reattached to pier.	
02/15/22	HazMat	21433 PACIFIC COAST Hwy	Diesel fuel spill	
02/18/22	Haz Cond	4254 AVENIDA DE LA ENCINAL	Electrical wiring/equipment problem, other	